



# G3LR12

---

---

## TECHNICAL SPECIFICATION FOR ALKALINE MANGANESE DIOXIDE BATTERY

DATE: 9/15/2005

SPEC. NO.: ES-G3LR12

REVISION: 2005C

---

---

### **GOLDEN POWER CORPORATION (HK) LTD.**

Flat C, 20/F, Block 1, Tai Ping Industrial Centre, 57 Ting Kok Road, Tai Po, N.T., Hong Kong

Tel: (852) 3125 2288 Fax: (852) 3125 2000 / (852) 3125 2001

E-mail: [battery@goldenpower.com](mailto:battery@goldenpower.com) Web Page: <http://www.goldenpower.com>

---

*The Manufacturer reserves the right to modify product specification and data stated herein without prior notice*

**1. Scope**

This Specification is applicable to Golden Power's Greenergy Alkaline Battery Model No.:G3LR12

**1.1 Designations**

Golden Power: G3LR12                      IEC: 3LR12                      Others: ---  
 JIS: 3LR12                                      ANSI: 3LR12

**1.2 Reference Document**

IEC 60086-1 (2000-11) --- Primary Batteries - Part 1: General  
 IEC 60086-2 (2001-10) --- Primary Batteries - Part 2: Physical and electrical specification  
 IEC 60086-5 (2000-07) --- Primary Batteries - Part 5: Safety of batteries with aqueous electrolyte

**2. Chemical System**

Alkaline-Manganese Dioxide

**\* MERCURY AND CADMIUM ARE NOT ADDED IN THE BATTERY**

**3. Nominal Voltage:**     4.5 V

**4. Average Weight :**     170 g

**5. Nominal Capacity**

4800mAh (condition: 20Ω load resistance, discharge 1 hours per day at 20+/-2°C, end-point voltage 2.7V )

**6. Electrical Characteristics**

Test conditions:     3.9Ω+/-0.5% load resistance, measuring time 0.3 seconds, temperature at 20+/-2 °C, tested within 30 days after delivery.

	Off-Load Voltage (V)	On-Load Voltage (V)	* Flush current (A)	Test Specification
New Battery	4.80	3.80	13.0	MIL-STD 105E, Class II, Double Sampling, AQL=0.4
After 3 mths. at 45°C	4.60	3.50	10.0	
After 12 mths. room temp	4.60	3.50	10.0	

**7. Service Output**

Condition: Test temperature 20 +/- 2°C, tested within 30 days after delivery

Standard	Discharge Condition			Average Minimum Discharge Time		
	Discharge Load	Discharge Time	E.P.V. (V)	New Battery	After 3 mths. at 45°C	After 12 mths. at room temperature
IEC	20Ω	1 h/d	2.7V	21 h	19 h	19 h
IEC	220Ω	4 h/d	2.7V	330 h	320 h	320 h
REF	20Ω	24 h/d	2.7V	20 h	18 h	18 h

Satisfaction Standard:

- 1) 9 pieces of battery will be tested for each discharging standard.
- 2) The result of the average discharging time from each discharging standard shall be equal to or more than the average minimum time requirement; and no more than one battery has a service output less than 80% of the specified requirement.
- 3) One re-test is allowed to confirm the previous result

## 8. Marking

The following markings will be printed, stamped or impressed on the body of the battery:

- (1) Designation : G3LR12
- (2) Manufacturer's name or abbreviation **"Golden Power Logo"**
- (3) Polarity: "+" or "-"
- (3) Warning: Battery may explode or leak if recharged or disposed of in fire

## 9. Caution for use

- (1) Since the battery is not manufactured for recharging, there are risks of electrolyte leakage or causing damage to the device if the battery is charged.
- (2) The battery shall be installed with its "+" and "-" polarity in correct position, otherwise may cause short-circuit.
- (3) Short-circuiting, heating, disposing of into fire and disassembling the battery are prohibited.
- (4) Battery cannot be forced discharged, which lead to excess gassing and, may result in bulging, leakage and de-crimping of cap.
- (5) New and used batteries cannot be used at the same time, when replaced batteries recommend to replace all and with the same brand type.
- (6) Exhausted batteries should be removed from compartment to prevent over-discharge, which cause leakage damage to the device.
- (7) Direct soldering is not allowed, which will damage the battery.
- (8) Battery should be kept out of the reach of children to prevent swallow, in case of accident should contact physician at once.

**10. Shelf Life** 2 years after delivery under proper storage conditions.  
(Temperature: 20+/-2°C; Relative humidity: 65+/-20%RH)

**11. Discharge Curves** (Condition: Test temperature 20+/-2°C)

Discharge Method: 220Ω 4 h/d (Ref to the Figure 1)

Discharge Method: 20Ω 1 h/d (Ref to the Figure 2)

**12. Battery Structure and Dimension:** Ref to Drawing DWG-S001

# GOLDEN POWER CORPORATION (HK) LTD.

Figure 1: G3LR12 DISCHARGE CURVE

Discharge Method: 220 ohm; Period: 4 h/d

Temperature: 20+/-2°C


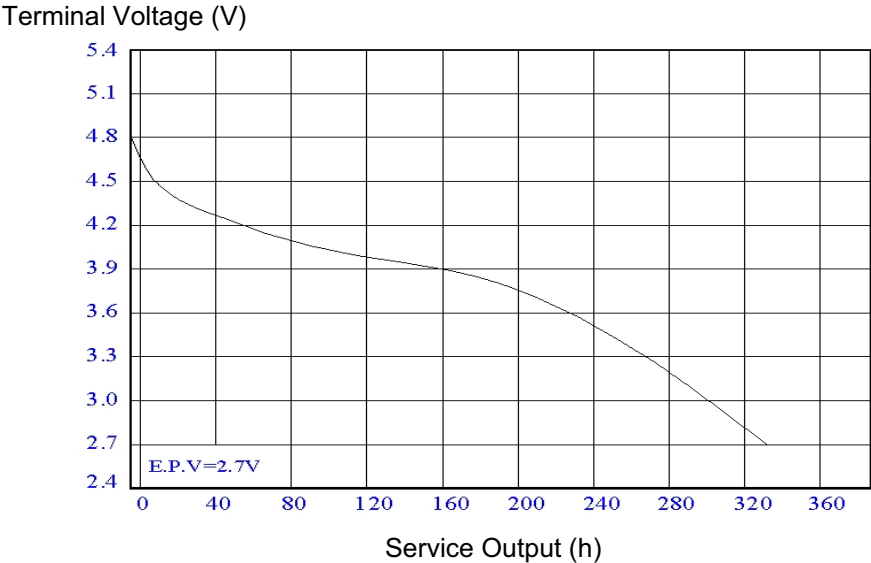


Figure 2: G3LR12 DISCHARGE CURVE


Discharge Method: 20 ohm; Period: 1 h/d

Temperature: 20+/-2°C

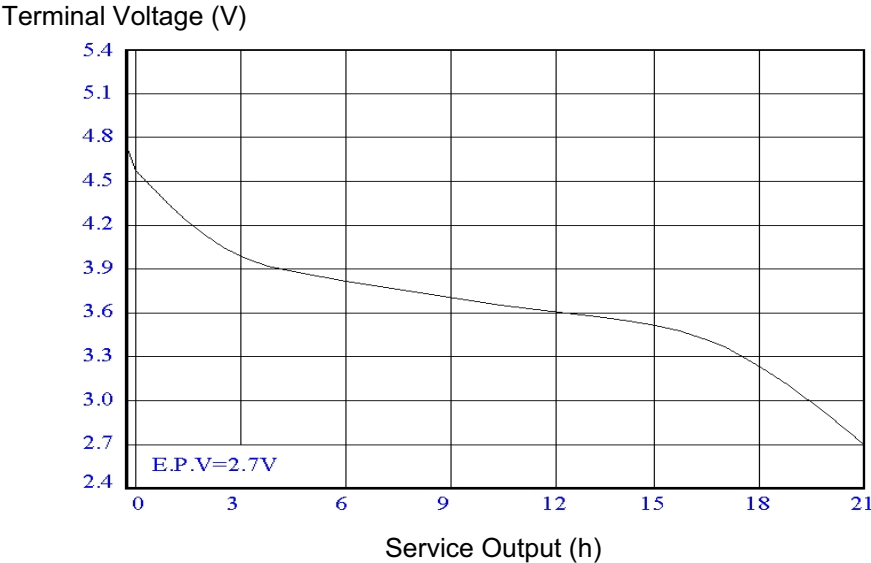

# G3LR12 BATTERY DIMENSION AND STRUCTURE

## G3LR12 電池外形及尺寸

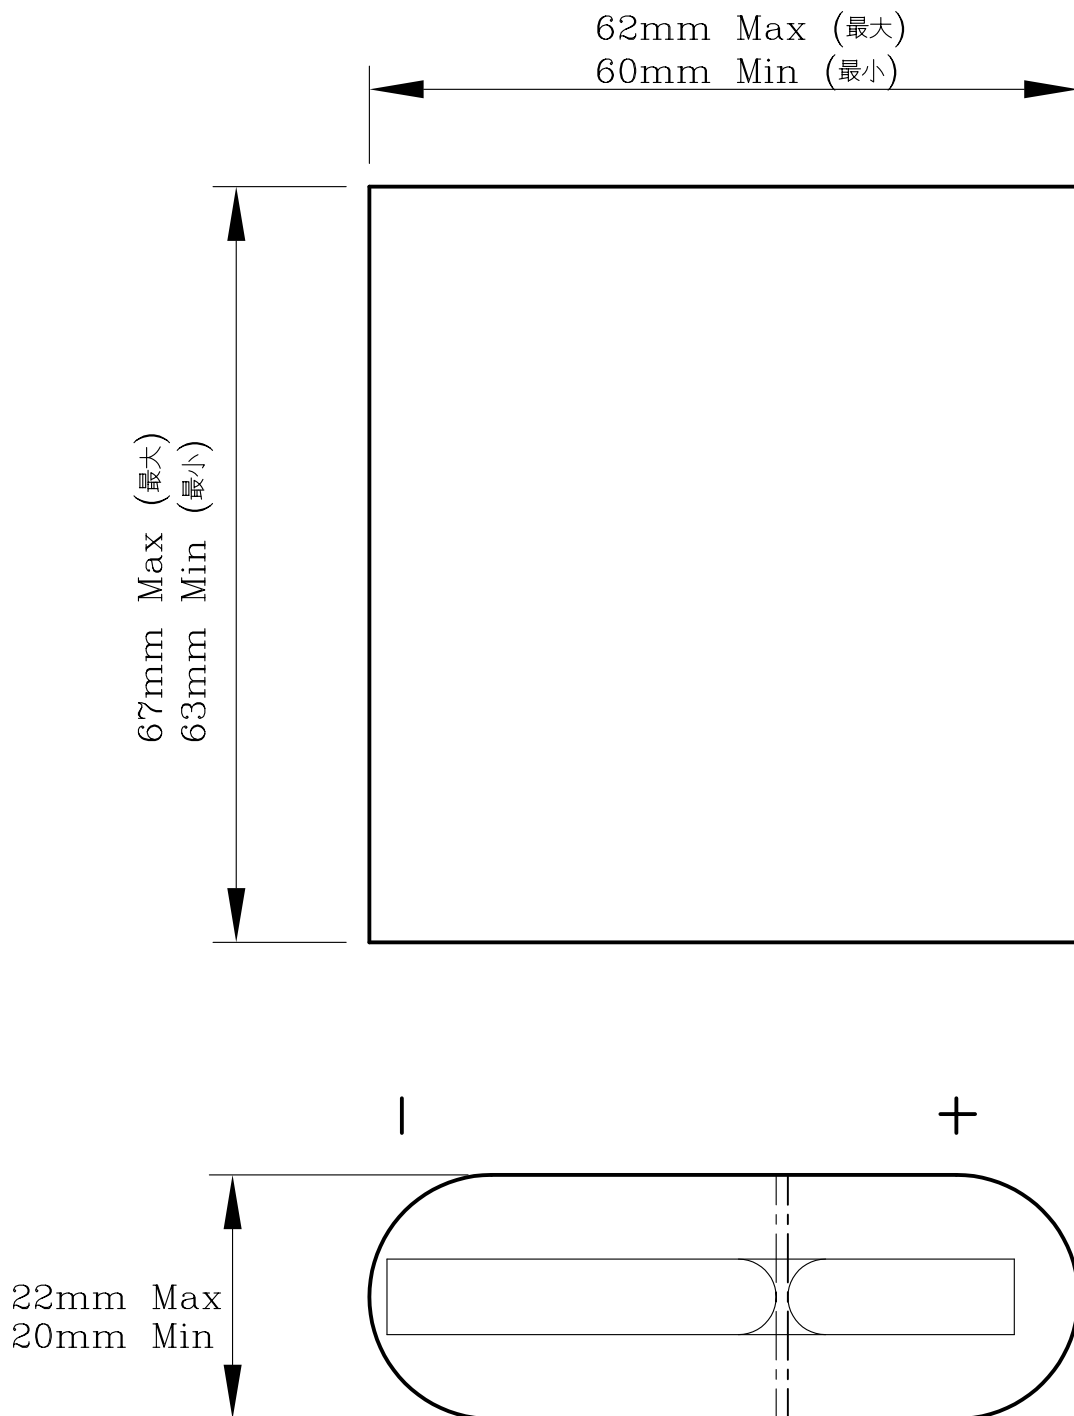

**GOLDEN POWER CORPORATION (HK) LTD.**

金力企業(香港)有限公司

MODEL(型號): G3LR12

DWG No.(圖號): DWG-S-001

SCALE(比例): NTS DIM(單位): mm

Approved by (審核):

DATE(日期): 15/9/05 DRAWN BY(繪制): Kelvin

Cecilia Chu

TOLERANCES (公差) LINEAR  $\pm 1$  3rd ANGLE PROJECTION  
ANGULAR  $\pm 1/4^\circ$  (第三角度視圖)